

GOVERNMENT OF TELANGANA
STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT

From:
Sri. C Laksjmi Prasad, M.A. PGDCS,
Additional Director of State Disaster Response
And Fire Services, Telangana, Hyderabad

To:
The District Education Officer,
Mahbub Nagar District,

Rc. No. 861/AD/FPW/2024, Dated 03-10-2024

Sir,

SUB: TELENGANA STATE DISASTER RESPONSE & FIRE SERVICES DEPARTMENT – Southern Region – Multi Stories Building – SARASWATHI HIGH SCHOOL, 505/A, Yeravalli X Roads, Itikyalla Mandal, Mahbubnagar Dist. 509125 – Issuance of **FIRE NO OBJECTION CERTIFICATE** – Regarding

REF: 1) Section 13(2) of A.P.Fire Services Act, 1999 and Rule 15(2) of A.P. Fire and Emergency Operations and Levy of Fee Rules, 2006.
2) Chief Office Cir. Memo. Rc. 15009/MSB/CR/HYD/2012, Dt. 13.04.2015
3) Application No. Nil. Dated 04/01/2016 of Sri V. Govardhan Reddy,
Correspondent SARASWATHI HIGH SCHOOL, 505/A, Yeravalli X Roads, Itikyalla Mandal,
Mahbubnagar Dist. 509125

Under the powers delegation vide reference 1st & 2nd the inspection committee of the Fire Prevention Wing has inspected the existing Multi-storeyed School Building of SARASWATHI HIGH SCHOOL, 505/A, Yeravalli X Roads, Itikyalla Mandal, Mahbubnagar Dist. 509125 on 28/09/2016 and submitted the following report.


The management has occupied the Multi-storeyed existing school building consisting of Ground + 2 floors with a height of 13.91 Metres for Educational Occupancy (School). The Management has submitted application for the issuance of Fire No Objection Certificate for existing building.

1A) PARTICULARS OF THE BUILDING:-

a)	Address of the building	SARASWATHI HIGH SCHOOL, 505/A, Yeravalli X Roads, Itikyalla Mandal, Mahbubnagar Dist. 509125
b)	Build-up area / height of the building	1945.95 Sq Mtrs / 13.91 Mtrs
c)	No of blocks / floors	One / Ground + first floor + second floor
d)	Type of Occupancy	Educational Building (B)

2) Floor wise details:

Sl. No.	Floor	Area in Sq. Metres	Occupancy (Educational/ Hostel/Dormitory occupancy)	Occupant Load as given by the management
1	Ground floor	648.65 Sq Mtrs	Educational	120
2	First floor	648.65 Sq Mtrs	Educational	120
3	Second floor	648.65 Sq Mtrs	Educational	120
	Total :	1945.95 Sq Mtrs		


Saraswathi High School (CBSE)
Yeravalli "X" Road

3) Open Spaces all around Building:-

	Open Space to be provided as per the G.O.Ms No. 86, MA & UD(M) Department, Section -7.1 in Table -III, Dated 03-03-2007	Open Spaces provided by the builder	Deficit
FRONT SIDE	03.00 Mtrs	60.6 Mtrs	NIL
SIDE-1	03.00 Mtrs	21.50 Mtrs	NIL
SIDE-2	03.00 Mtrs	8.50 Mtrs	NIL
REAR SIDE	03.00 Mtrs	6.00Mtrs	NIL

4) Strict compliance with all fire safety provision as per the condition of Fire No Objection Certificate issued vide Part 4 National Building code of India and of Building rules, particularly the following should be ensured at all time.

Fixed and First-aid Fire Fighting equipment, alarm etc shall be tested and maintained regularly as per applicable standards and Fire Drills conducted quarterly for first two years and three after half yearly.

No temporary structure such as tents or with thatched construction should be allowed for educational institutions.

Emergency power generator etc., and associated equipment like feeds, should periodically verified as per NBC, and IS-1646.

Every room with a capacity of 45 students shall be maintained obstruction free minimum two doorways. Every vertical opening between at the floors shall be suitably enclosed or protected, with ventilation System by ducts and Balconies.

The Builder/ Occupier should facilitate periodical inspection by jurisdiction Station Fire Officer and District Fire Officer, Fire Prevention Wing, GHMC, Hyderabad.

Sl.No.	Fire Safety Measures	Required as per table 23 of NBC of India 2005	Provided	Deficiencies
1)	Fire Buckets	Required	Provided 10 Nos.	Nil
2)	Fire Extinguishers ABC Type 05 K.G Capacity	Required	Provided 10 Nos.	Nil
3)	Public Address System	Required	Provided	Nil

5) In view of the above Fire No Objection Certificate for the Existing Building from the fire safety points of view is issued subject to the following conditions.

1) **The NOC issued is confirmed to the Fire Safety measures installed in the building and doesnot confer any Legal right for claiming Ownership of property or Conversion of land use/ Occupancy or Building Regularization. The Owner/ Occupier shall comply the Building Rules/ Govt. Orders as applicable.**


2) Evacuation plan showing exist routes and recommended action plan be displayed at conspicuous locations and shall be exhibited at all times all escape/exit routes shall not be locked or encroached.

3) Fresh NOC would be required for any change in occupancy or addition/alterations in the building structure as per NBC and building bye laws.

4) The management has to maintain Fire Safety measures at all times in good working Condition as seen during the inspection.

5) Any loss of life or property due to Non-functioning of Fire Safety Measures and other installations shall be the responsibility of the management/owner.

6) All the occupants should know the correct method of operation of the Fire Fighting System installed.


PRINCIPAL
Saraswathi High School (CBSE)
Yerravalli "X" Road

- 7) All the occupants/ security personnel shall be trained to operate the Fire Safety Equipment during the Emergency.
- 8) Additional/ Alteration, if any, in the building may be verified by building authority.
- 9) The Fire Drills shall be conducted once in every six months for initial two years, thereafter once in every 6 months.
- 10) Fire No Objection Certificate issued is valid for one year from the date of issue. It is the responsibility of the Builder/ Occupier to apply for renewal one month before expiry.

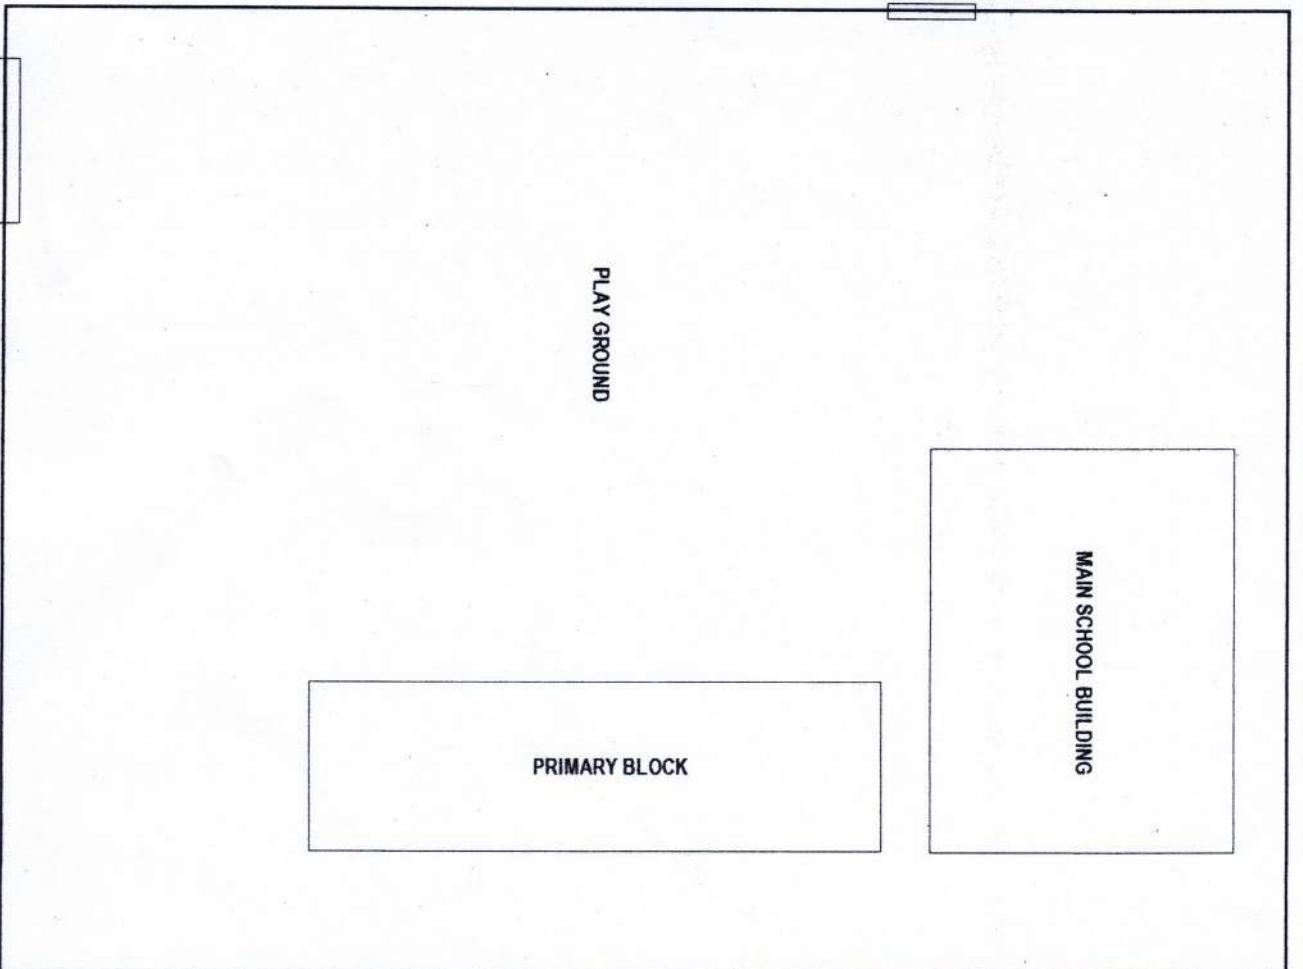

ADDITIONAL DIRECTOR

State Disaster Response And Fire Services
Hyderabad, Telangana

Copies to:

Sri V. Govardhan Reddy, Correspondent SARASWATHI HIGH SCHOOL, 505/A, Yeravalli X Roads,
Itikyalla Mandal, Mahbubnagar Dist. 509125
Asst. Dist Fire Officer, Mahbub Nagar Dist.
Incharge Station Fire Officer, Itikyala Mandal


PRINCIPAL
Saraswathi High School (CBSE)
Yerravalli "X" Road



LAYOUT OF SURVEY NO. 493, 463, 496,
463C, 505/A AT YERAVALLI X ROADS,
TIRUKYALLA MANDAL, DIST.
MAHBUBNAGAR (T.S)

PROPOSED CBSE SCHOOL -
SARASWATHI HIGH SCHOOL

DETAILS OF AREA BASEMENT

TOTAL PLOT AREA : 2.34 Acres or 11335.27 Sq Yard

TOTAL NO. OF FLOORS:

GROUND + (2) UPPER FLOORS

BUILT UP AREA:

MAIN SCHOOL BUILDING

GROUND FLOOR : 648.95 Sq. Mts

FIRST FLOOR : 648.95 Sq. Mts

SECOND FLOOR : 648.95 Sq. Mts

TOTAL : 1946.95 Sq. Mts

AS BUILT HEIGHT : 13.91 Mts

PRIMARY BLOCK

GROUND FLOOR AREA: 490.52 Sq. Mts

PLAYGROUND AREA : 4328.45 Sq. Mts

138.56

SIGNATURE OF OWNER:

SIGNATURE OF CIVIL CONTRACTOR:


PRINCIPAL
Saraswathi High School (CBSE)
Yerravalli "X" Road



WIPRO FIRE & SAFETYTM

(FIRE PROTECTION ENGINEERS & CONSULTANTS)

62/29A, Chithambarao Street, Kurnool-518001. A.P.
Tel. Fax : 08518-244660, Cell : +91-94403 63701, +91-9493114080
E-mail : wiprofiresafety@gmail.com, wiprofiresafety@yahoo.com



AN ISO 9001 : 2008
ISO 9001 : 2015
Certified Company

TEST CERTIFICATE

This is to certify that the following Fire Extinguishers have been tested by us.
As per Relevant IS specification and supplied to M/s SARASWATHI HIG
SCHOOL ERVALI DATE: -04/08/2017 is warranted for a period of one
year from the date of

S.No	DESCRIPTION	Qty	Test Pressure	ISI No.	Result
1.	SUPPLY of Co2 2Kg Capacity Fire Extinguisher	01 Nos	30Kg	2878	OK
2.	SUPPLY of ABC 6Kg Capacity Fire Extinguisher	04Nos	30Kg	2171	OK

Further, we certify that the above material are made of best quality in
Workmanship free from all defects in material and workmanship, if
Inconsistency in the performance of the material in that event we undertake
Free repairs or replacement during the warrantee period.
Next Due Date: 03/08/2018

THANKING YOU SIR,

For WIPRO FIRE SAFETY

AUTHORISED SIGNATURE


PRINCIPAL
Saraswathi High School (CBSE)
Yerravalli "X" Road

HYDERABAD - VIJAYAWADA - NELLORE - BELLARY - VIZAG

STOCKIST, SUPPLIERS, CONTRACTORS OF ALL TYPES OF FIRE HYDRANT, SPRINKLERS SYSTEMS, FM 200 SYSTEM, FIRE ALARM SYSTEM,
MFG FIRE EXTINGUISHERS, AND INDUSTRIAL SAFETY EQUIPMENTS, ROAD SAFETY EQUIPMENTS ETC.,

CASH / CREDIT BILL

Cell : +91-94403 63701

☎ : 08518-244660



(Fire Protection Engineer)

AN ISO-9001-2008

Certified Company

WIPRO FIRE & SAFETY

(FIRE PROTECTION ENGINEERS & CONSULTANTS)

No. 62/29A, Chithambarao Street, KURNOOL - 1. (A.P.)

E-mail : wiprofiresafety@gmail.com, wiprofiresafety@yahoo.com

No. **380**

Date :

To M/S - Saraswathi High School, Yerravalli Chavandhra

Sl. No.	QTY.	PARTICULARS	Price Each	Amount Rs. Ps.
1,	04 Nos	Supply of "ABC 6kg Capacity fire Extinguisher" Universal Brand	2300	9200-00
2,	02 Nos	Supply of "Hosereel drums" 30mtr Hose with nozzle (Universal)	4500	9000-00
03,	01 Nos	Supply of "CO2 2kg Capacity fire Extinguisher" Universal Brand	3500	3500-00
04,	02 Nos	Supply of "Leather fire Jack-hammer"	150	300-00
TOTAL				22,000-00

Subject to Kurnool Jurisdiction

Goods once sold cannot be taken back or Exchange

WIPRO FIRE & SAFETY

PRINCIPAL

Saraswathi High School (CBSE)
Yerravalli "X" Road